




JØTUL F 500 ECO

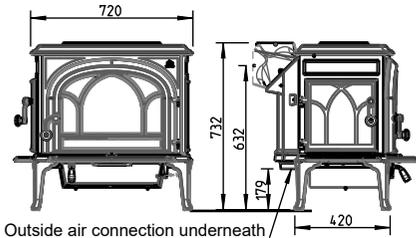


Outside air connection underneath
Ø100mm (optional extra)

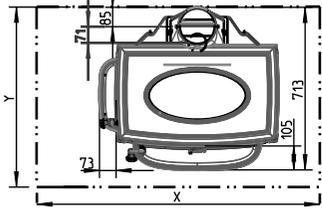

Min. measurement floorplate
X/Y Acc. to national standards

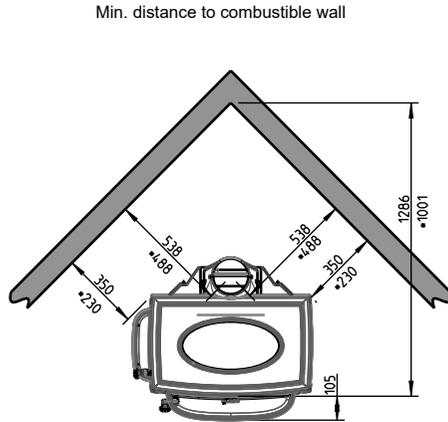

* With heat shield rear and insulated flue pipe

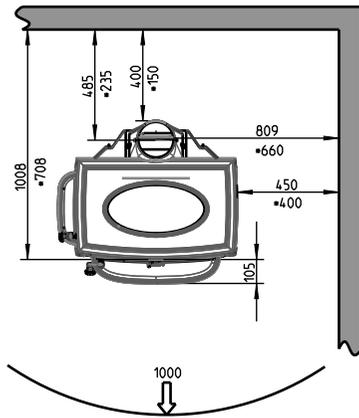

* With heat shield rear and insulated flue pipe






Combustible wall



Firewall (See chapter 3.3 in the manual)

Min. distance to combustible wall protected by firewall

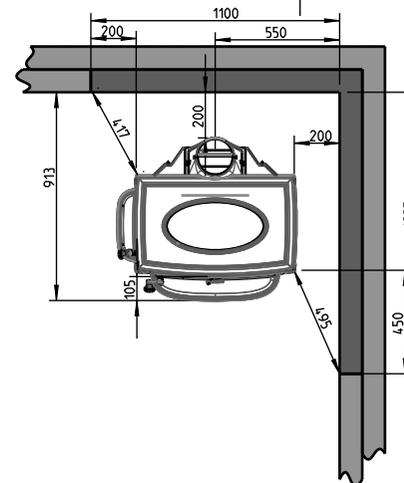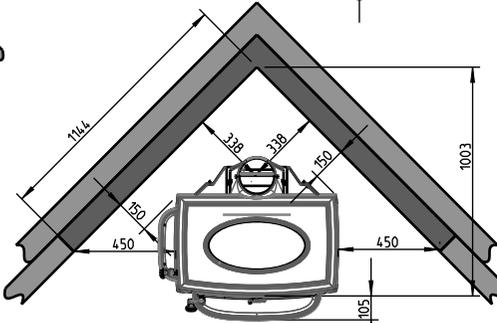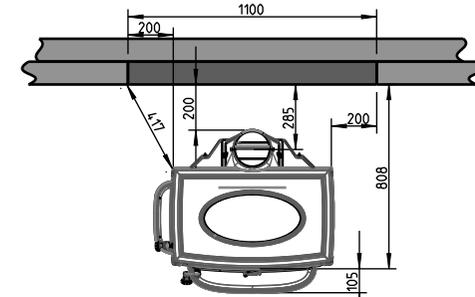

Min. distance to combustible wall protected by firewall

